

LX5V-4ADI-BD BD Module Manual

1 Installation

- Before installation, it must be ensured that the PLC host and the related device of the BD module terminal wiring are powered off reliably. The shell is inserted into the BD module slot of PLC host, and then locked with two standard screws for fixation.
- Two standard terminal heads are equipped with this BD module. After connecting the wiring, insert them into its terminal. After confirming that the host, BD module, wiring, etc. are installed correctly, it can be powered on for use.
- **Note:**
 - The ADI input must not exceed the absolute maximum (-2mA/+ 30mA), otherwise the BD module will be damaged.
 - Please install the BD module firmly and fix it on PLC. Poor contact may lead to failure.
 - Tightening torque for fixing BD module or PLC top cover is 0.3N.m to 0.6N.m. Please tighten it firmly to avoid malfunction.
 - **You can only use a LX5V-4ADI-BD on the PLC main unit of LX5 series.**
- **Warning: Cut off the power before installing, removing or wiring the BD module to avoid electric shock or product damage.**

2 Appearance and terminal

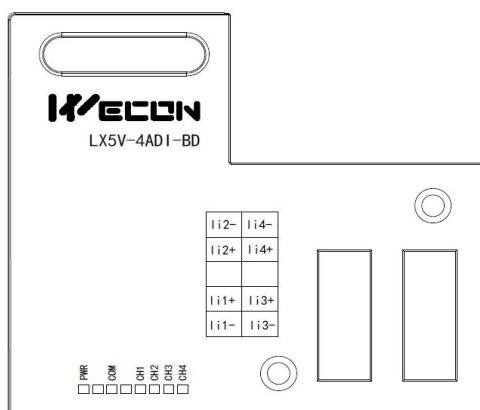


Table1 Terminal distribution

Input current range: 4mA to 20mA			
I11-	Channel 1 current input negative	I14-	Channel 4 current input negative
I11+	Channel 1 current input positive	I14+	Channel 4 current input positive
	NC		NC
I12+	Channel 2 current input positive	I13+	Channel 3 current input positive
I12-	Channel 2 current input negative	I13-	Channel 3 current input negative

Table2 LED lamp function description

Indicator lamp	Description
PWR	ON when power-on (when the program is running, it will be ON).
COM	It flashes when communicating with PLC normally, and it is OFF when timeout.
CH1	Channel 1 lamp: Always on in range; Flashing outside the range of (4mA to 20mA); Off when the channel is closed.
CH2	Channel 2 lamp: Always on in range; Flashing outside the range of (4mA to 20mA); Off when the channel is closed.
CH3	Channel 3 lamp: Always on in range; Flashing outside the range of (4mA to 20mA); Off when the channel is closed.
CH4	Channel 4 lamp: Always on in range; Flashing outside the range of (4mA to 20mA); Off when the channel is closed.

3 Specification

- (1) General specification: Same as PLC main unit. (Please refer to the accompanying manual of the PLC main unit.)
- (2) Power supply specification: The power supply is provided internally by PLC
- (3) Performance specifications:

Project	Description
Power supply	5VDC \pm 10%, 70mA (The power supply is provided internally by host)
Analog input range	DC 4mA to 20mA (input resistor 250 Ω) absolute maximum input: -2mA, +30mA
Rated range	4mA to 20mA: 0 to 2000 (recommended)
Maximum display range	-500 to 2048
Resolution	8 μ A (4mA to 20mA/2000)
Comprehensive precision	\pm 0.5% of full scale (4mA to 20mA: \pm 0.08 mA)
A/D conversion time	One scan cycle (A/D conversion after ladder diagram END instruction is executed, and BD channel map value is updated)
Input features	
Insulation	There is no insulation between the channels of the module
Points occupied	0 point (4ADI is not affected by the standard maximum control points of the main PLC because it is operated through the data register)

4 Wiring



Warning

Cut off the power before installing, removing or wiring the BD module to avoid electric shock or product damage.

Note:


- Do not place signal cables near high voltage power cables or in the same trunk line. Otherwise, it may be disturbed or surged. Keep a safe distance between signal cable and power cable, at least 100mm.
- Ground the shielding of shielded wire or shielded cable. But the ground point and high voltage line cannot be the same.
- Do not connect cables of impermissible size to avoid poor contact or product damage.
- Fix the cable so that no force directly acts on the terminal line or cable connection area.
- The tightening torque of terminal is 0.5Nm to 0.6N.m. Please tighten it to prevent malfunction.
- Do not use empty terminals.

4.1 Applicable cables


- (1) AWG25-16 is used for connection with output device.
- (2) Maximum terminal tightening torque is 0.5N.m to 0.6N.m.
- (3) Using different types of cables may cause poor contact with terminals. Please use pressfit terminals for good contact.

Line number and cross-sectional area

Line number	Cross-sectional area (mm ²)	End processing
AWG26	0.1288	Stranded cable: Strip off the sheath, rub the core wire, and then connect the cable.
...	...	
AWG16	1.309	Single-core cable: Strip off the sheath and connect the cable.



4.2 Current input mode

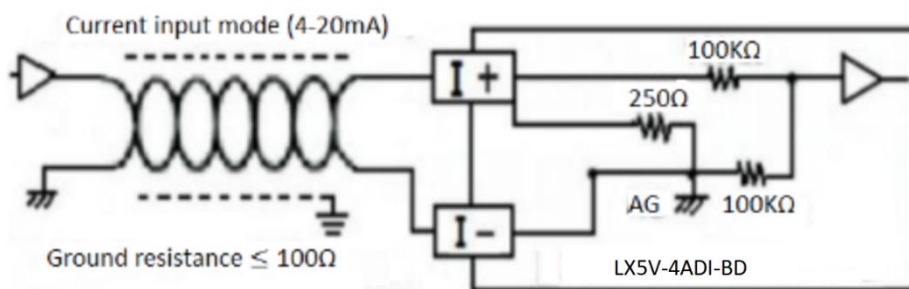

5 Description of PLC device

- (1) When connected to LX3 series PLC, please refer to LX3 series BD module manual.
- (2) When connected to LX5 series PLC, if the firmware version of PLC is lower than 2.051 (excluding 2.051), or BD module is not configured by host computer, it can be controlled by the following system devices:

Table3Device allocation


PLC model	BD model	Device	Description	Device	Description	
LX5V	4ADI	SM2010	CH1 current input channel open flag	OFF: Open ON: Close	SD2010	CH1 digital value (4mA to 20mA: 0to 2000)
		SM2011	CH2 current input channel open flag		SD2011	CH2 digital value (4mA to 20mA: 0to 2000)
		SM2012	CH3 current input channel open flag		SD2012	CH3 digital value (4mA to 20mA: 0to 2000)
		SM2013	CH4 current input channel open flag		SD2013	CH4 digital value (4mA to 20mA: 0to 2000)

- (3) You can select device through I/O mapping to use the configuration function of new BD module. For details, please refer to "[6.1 Parameter configuration](#)".

6 Instructions


6.1 Parameter configuration

- ① Open the host computer software and create a new project, double-click "Project Manager" → "Extended Function" → "BD Module Configuration" ^{Note} to enter "BD settings" interface;
- ② Configure the currently connected PLC (take the LX5V-2416 model as an example) and BD module model on the BD module configuration interface: Select "LX5V-4ADI" in the device bar on the right side of the BD module configuration interface and double-click to add it to the corresponding slot position of PLC (slot number 1 or 2, the software will select slot 1 by default, and right-click to move down to slot 2);
- ③ After adding the BD module to the slot, double-click or right-click to select configuration parameters to enter LX5V-4ADI-BD configuration parameters interface, as shown in the following figure. Configure related parameters on this interface.

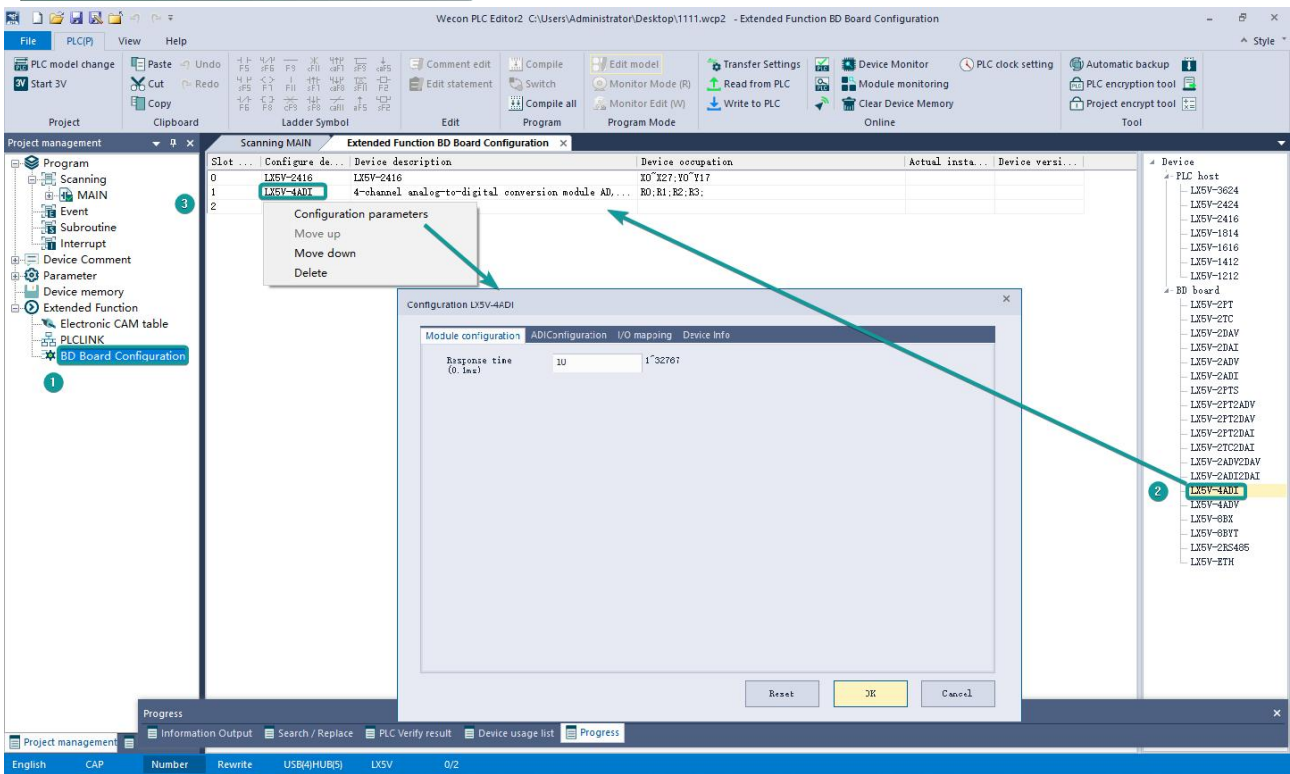


Note: This function is only supported in the following versions of host computer, slave computer and BD module:

(1) Supported host computer versions: Wecon PLC Editor2 2.1.204 and above, as shown in the following figure:

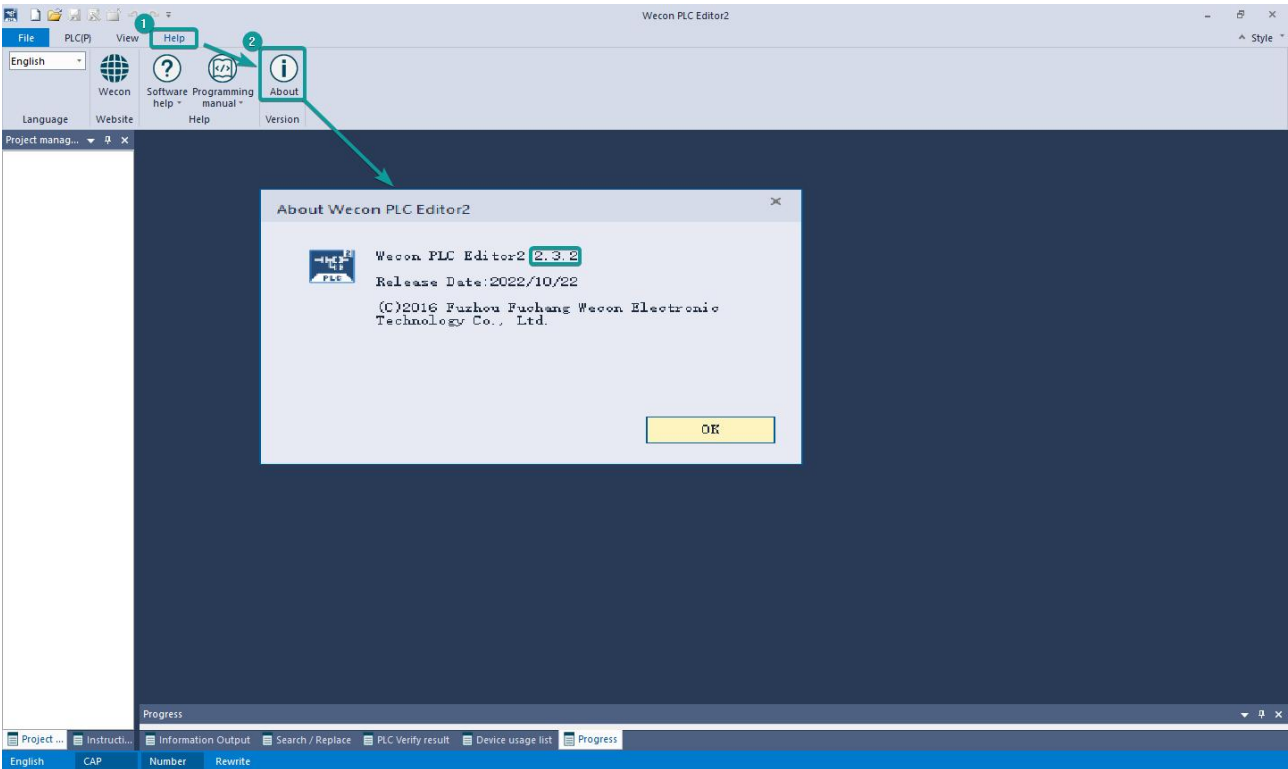

(2) Supported slave computer versions: 2.051 and above, as shown in the following figure:

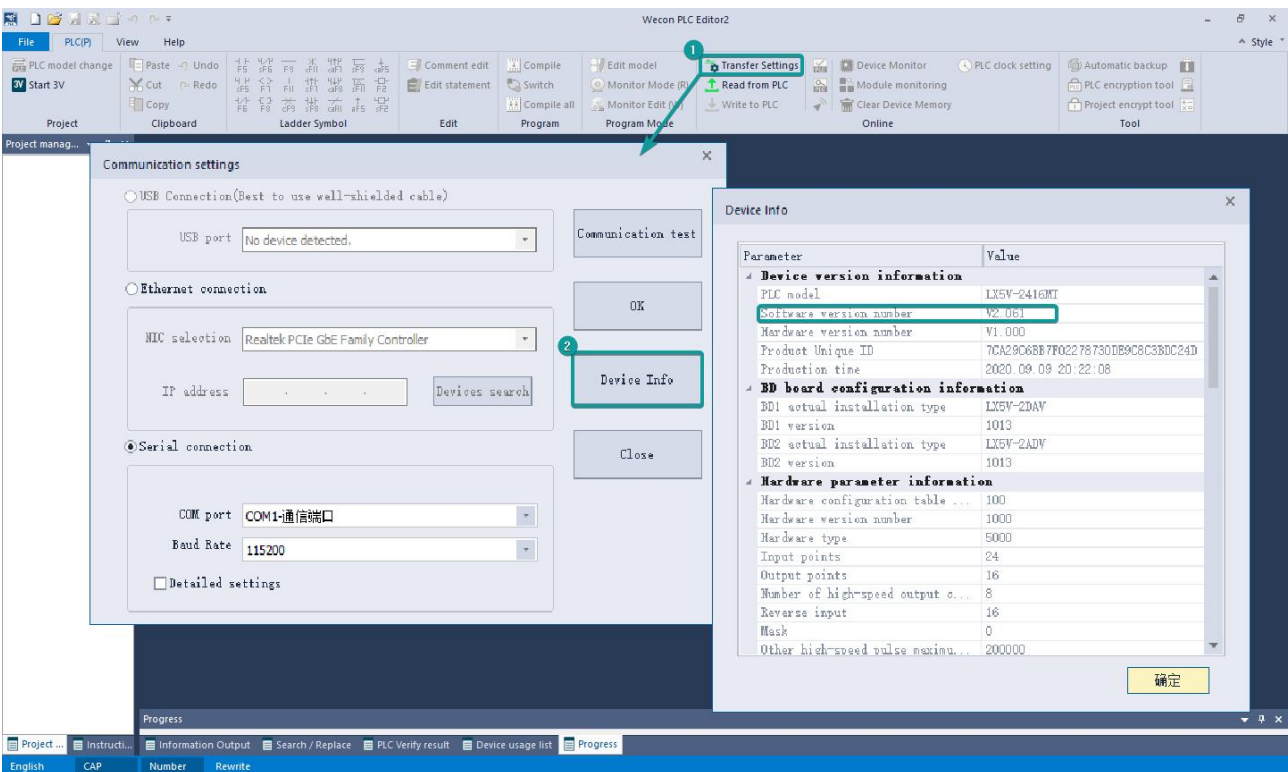

(3) Supported BD module version number: 1013 and above, as shown in the following figure:


Slot ...	Configure de...	Device description	Device occupation	Actual insta...	Device versi...
0	LX5V-2416	LX5V-2416	X0~X27;Y0~Y17	LX5V-2416MT	V2.061
1	LX5V-4ADI	4-channel analog-to-digital conversion module AD...	BD;R1;R2;R3;	LX5V-4ADI	1013
2					

The parameter configuration interface is as below:

1、Module setting: Set response time (The response time is the interval time between PLC acquisition of BD module data. Range: 0.1ms to 3276.7ms).



2、ADI configuration:

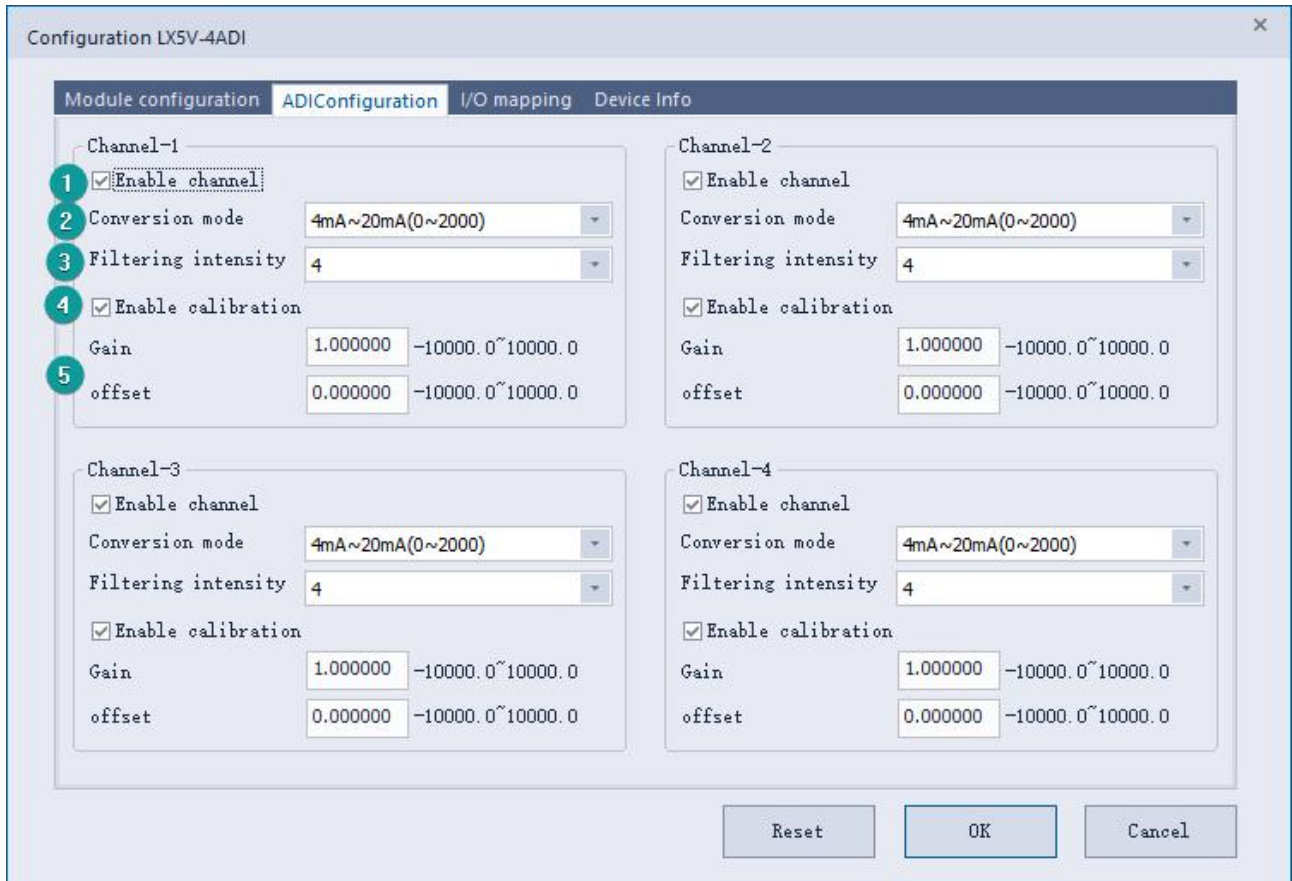


- ① Check enable channel to set whether to enable the current BD module channel.
- ② The conversion mode is set to ADI conversion mode by default, and the measurement range is 4mA~20mA (0~2000).
- ③ Setting the filtering intensity can reduce the jitter of BD channel value. The default configuration of filter intensity is 4. Level 0 is the lowest and level 9 is the highest. The filter intensity can be adjusted according to actual use.
- ④ Check enable calibration, you could calculate the gain offset according to the following formula to convert the corresponding channel value:
Channel value = digital value × gain value + offset value
- ⑤ When the channel value deviates, you could also set the gain offset to calibrate the channel. For example:
 - When the channel input analog is 20mA, the digital quantity of BD module acquisition channel value is 1970, and the actual digital value should be 2000.
 - When the channel input analog is 4mA, the digital quantity of BD module acquisition channel value is 30, and the actual digital value should be 0.


Suppose the gain is a , and the offset is b , then
$$\begin{cases} 2000 = 1970 * a + b \\ 0 = 30 * a + b \end{cases},$$

Solve and get
$$\begin{cases} a = 1.030928 \\ b = -30.92784 \end{cases}$$
 The calibration can be completed by setting the corresponding gain offset to the current channel.

3、 Set I/O mapping. The channels are mapped to R device according to the current number of BD module channels by default. As shown in the following figure, BD module CH1 to CH4 is mapped to device R0 to R3.

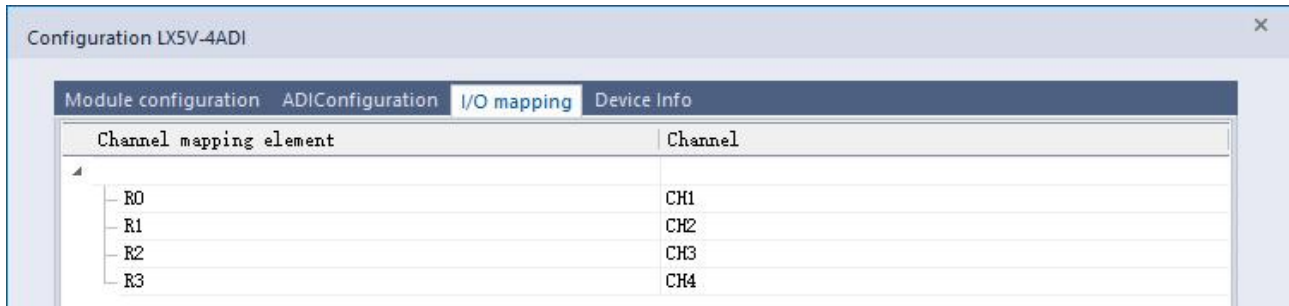

4、 After the above configuration is completed, check the program, download the configuration to PLC, and STOP→RUN configuration takes effect.

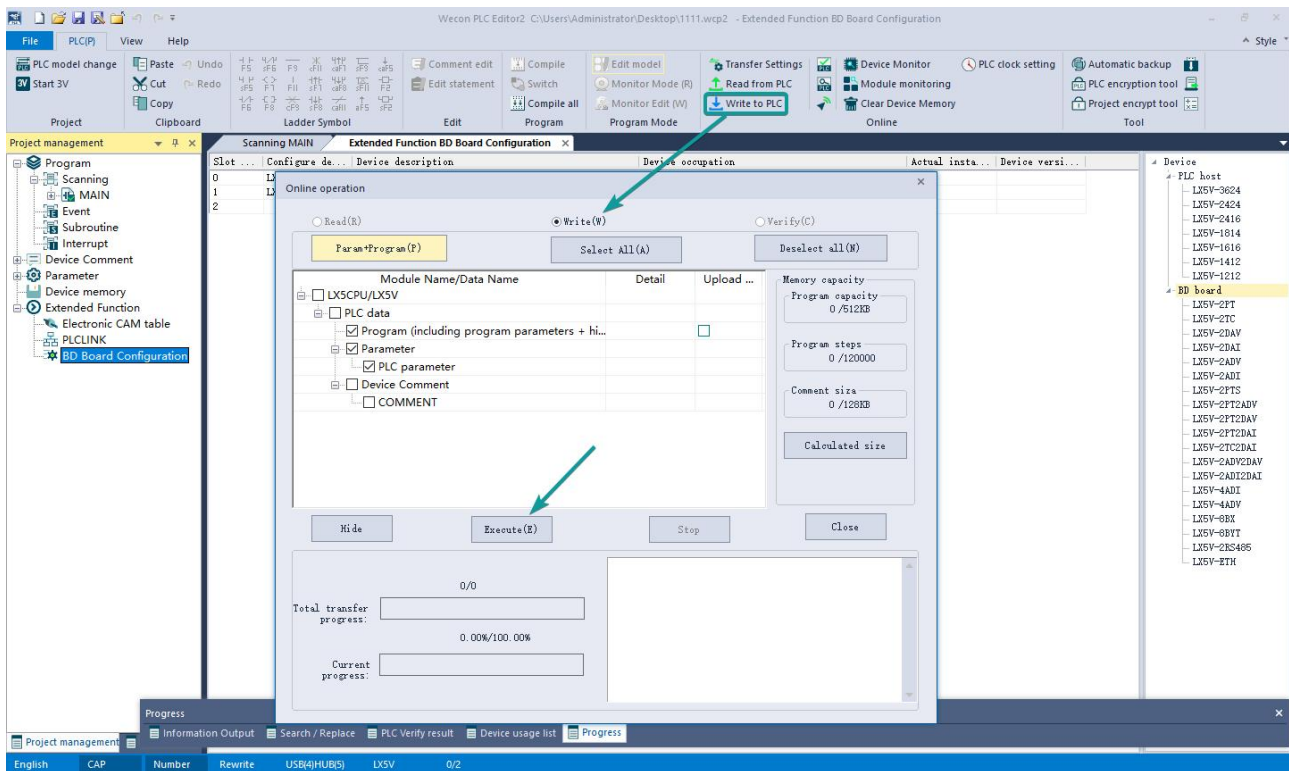

6.2 Ladder Diagram

1、Do not use the host computer software "BD module configuration" function programming example. For device allocation, please refer to "[5 PLC device description](#)".

```

/*
 * Open bd board 4 channels
 */
0  SM102
   |
   |-----[RST] SM2010 } Turn on the CH1 current input channel
   |-----[RST] SM2011 } Turn on the CH2 current input channel
   |-----[RST] SM2012 } Turn on the CH3 current input channel
   |-----[RST] SM2013 } Turn on the CH4 current input channel
   |
   |
   |

/*
 * Channel values are mapped to D0~D3
 */
10 SM100
    |
    |-----[MOV] SD2010 D0 } Write the digital value of CH1 to register D0
    |-----[MOV] SD2011 D1 } Write the digital value of CH2 to register D1
    |-----[MOV] SD2012 D2 } Write the digital value of CH3 to register D2
    |-----[MOV] SD2013 D3 } Write the digital value of CH4 to register D3
    |
    |
    |
  
```


2.Programming example using "BD module configuration" function of host computer software:

```

/*
 * BD board channel values are mapped to R0~R3 via I/O
 */
40 SM100
    |
    |-----[MOV] R0 D0 } Map CH1 into R0 device
    |-----[MOV] R1 D1 } Map CH2 into R1 device
    |-----[MOV] R2 D2 } Map CH3 into R2 device
    |-----[MOV] R3 D3 } Map CH4 into R3 device
    |
    |
    |
  
```

6.3 BD monitoring interface and buffer memory

Open the module monitoring interface, select BD module, select LX5V-4ADI from the list of BD modules on the right to monitor it online, and check the current BD module communication status and error information in time.

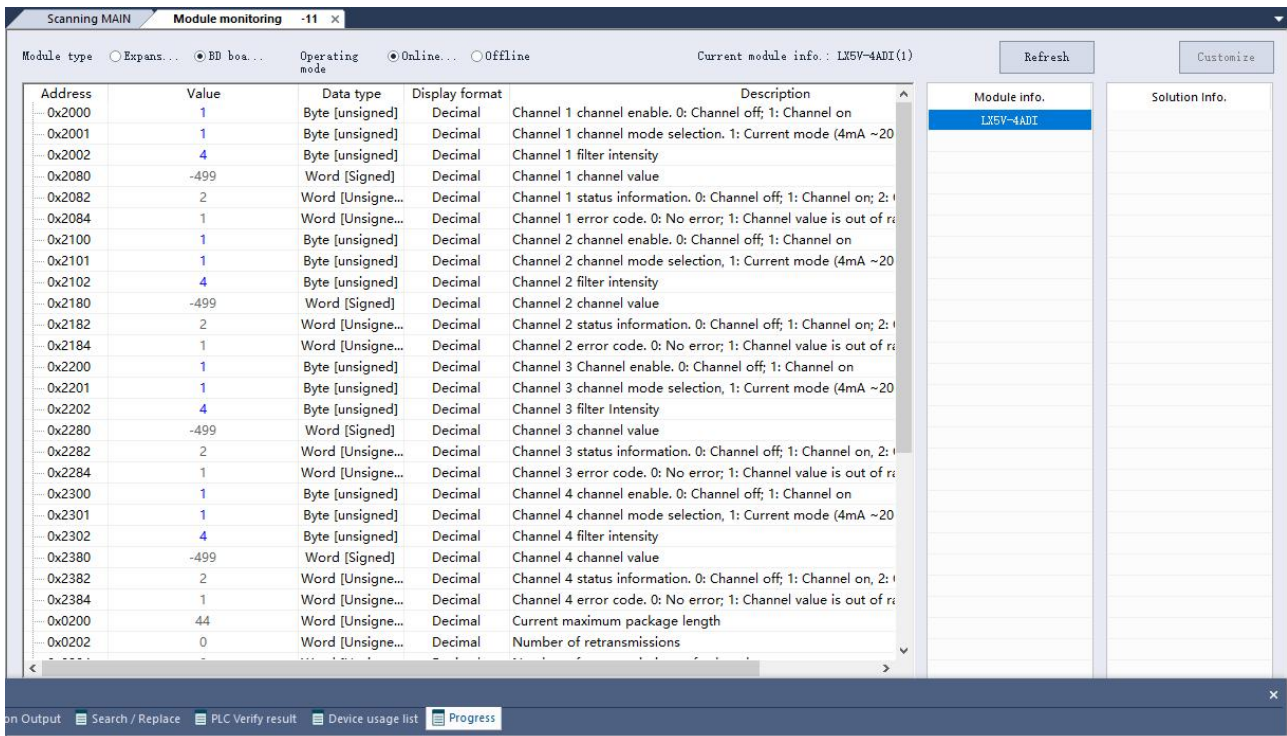

① 4ADI buffer memory (BFM): Used for 4ADI-BD module status monitoring.

BFM addresses	Power-off hold	Read-write	Memory name	Default	Range	Description
0x2000	×	R/W	Channel 1 channel enable	1	0 to 1	0: Channel closed; 1: Channel open
0x2001	×	R/W	Channel 1 channel mode selection	1	1	1: Current mode (4mA to 20mA)
0x2002	×	R/W	Channel 1 filter intensity	4	0 to 9	0: Minimum filter strength; 9: Maximum filter strength
0x2080	×	R	Channel 1 channel value	0	0 to 2000	
0x2082	×	R	Channel 1 status information	0	0 to 2	0: Channel closed; 1: Channel opened 2: Channel value exceeds the range
0x2084	×	R	Channel 1 error code	0	0 to 1	0: No error; 1: Channel value exceeds the range
0x2100	×	R/W	Channel 2 channel enable	1	0 to 1	0: Channel closed; 1: Channel open
0x2101	×	R/W	Channel 2 channel mode selection	1	1	1: Current mode (4mA to 20mA)
0x2102	×	R/W	Channel 2 filter intensity	4	0 to 9	0: Minimum filter strength; 9: Maximum filter strength
0x2180	×	R	Channel 2 channel value	0	0 to 2000	
0x2182	×	R	Channel 2 status information	0	0 to 2	0: Channel closed; 1: Channel opened 2: Channel value exceeds the range
0x2184	×	R	Channel 2 error code	0	0 to 1	0: No error; 1: Channel value exceeds the range
0x2200	×	R/W	Channel 3 channel enable	1	0 to 1	0: Channel closed; 1: Channel open
0x2201	×	R/W	Channel 3 channel mode selection	1	1	1: Current mode (4mA to 20mA)
0x2202	×	R/W	Channel 3 filter intensity	4	0 to 9	0: Minimum filter strength; 9: Maximum filter strength

0x2280	×	R	Channel 3 channel value	0	0 to 2000	
0x2282	×	R	Channel 3 status information	0	0 to 2	0: Channel closed; 1: Channel opened 2: Channel value exceeds the range
0x2284	×	R	Channel 3 error code	0	0 to 1	0: No error; 1: Channel value exceeds the range
0x2300	×	R/W	Channel 4 channel enable	1	0 to 1	0: Channel closed; 1: Channel open
0x2301	×	R/W	Channel 4 channel mode selection	1	1	1: Current mode (4mA to 20mA)
0x2302	×	R/W	Channel 4 filter intensity	4	0 to 9	0: Minimum filter strength; 9: Maximum filter strength
0x2380	×	R	Channel 4 channel value	0	0 to 2000	
0x2382	×	R	Channel 4 status information	0	0 to 2	0: Channel closed; 1: Channel opened 2: Channel value exceeds the range
0x2384	×	R	Channel 4 error code	0	0 to 1	0: No error; 1: Channel value exceeds the range

② Universal buffer memory (BFM): used to diagnose the communication status of the currently connected BD module.

BFM address	Power-off hold	Read-write Function	Memory name	Default	Range	Description
0x200	×	R	Current maximum package length	0	0 to 0xFFFF	The maximum length of the currently sent package
0x202	×	R	Number of retransmissions	0	0 to 0xFFFF	Number of retransmissions
0x204	×	R	Number of retransmissions of subpackages	0	0 to 0xFFFF	Number of retransmissions of subpackages
0x206	×	R	Received times of sync frames	0	0 to 0xFFFF	Received times of sync frames
0x208	×	R	Sent times of sync frames	0	0 to 0xFFFF	Sent times of sync frames
0x20A	×	R	Control the number of transmissions	0	0 to 0xFFFF	Control the number of transmissions
0x20C	×	R	Control the number of receptions	0	0 to 0xFFFF	Control the number of receptions
0x20E	×	R	Number of subscriptions sent	0	0 to 0xFFFF	Number of subscriptions sent
0x210	×	R	Number of subscriptions received	0	0 to 0xFFFF	Number of subscriptions received
0x212	√	R/W	Latest error code	0	Only 0 can be written.	Protocol internal error code, write 0 to clear
0x214	×	R	Number of bytes sent	0	0 to 0xFFFFFFFF	Number of bytes sent
0x218	×	R	Number of valid bytes sent	0	0 to 0xFFFFFFFF	Number of valid bytes sent
0x21C	×	R	Number of bytes received	0	0 to 0xFFFFFFFF	Number of bytes received
0x220	×	R	Number of valid bytes received	0	0 to 0xFFFFFFFF	Number of valid bytes received
0x224	×	R	Communication time (unit s)	0	0 to 0xFFFFFFFF	Normal communication time since the BD module is powered on